

Branch Panel:PP-1

Location:
Supply From:
Mounting: Recessed
Enclosure: Type 1

Volts: 120/208 Wye
Phases: 3
Wires: 4

A.I.C. Rating:
Mains Type:
Mains Rating: 100 A
MCB Rating: 1 A

Notes:

CKT	Circuit Description	Trip	Poles	A	B	C	Poles	Trip	Circuit Description	CKT
-----	---------------------	------	-------	---	---	---	-------	------	---------------------	-----


1	Receptacle HALL AREA	20 A	1	360 VA 540 VA		1	20 A	Receptacle STDDY	4
3	Receptacle OPEN TO BELLOW	20 A	1		360 VA 720 VA		1	20 A	Receptacle DINING
5	Receptacle GUEST ROOM	20 A	1			540 VA 1080	1	20 A	Receptacle MEDIA ROOM, BED-2

9	Receptacle REFRIGERATOR	20 A	1	1500... 6500...		1	50 A	Receptacle AC UNIT		8
9	Receptacle WATER HEATER MASTER BED	20 A	1	1500... 6500...		1	50 A	Receptacle AC UNIT SECOND FLOOR		10
11	Receptacle FAMILY LOUNGE	25 A	1	2200... 5000...		1	40 A	Receptacle SCAB CABINET		12

13	Receptacle FAMILY LOUNGE	20 A	1		220V...	1	40 A	Receptacle COIN CHANGE	12
14	Receptacle LIVING	20 A	1	720 VA 1500...		1	20 A	Receptacle LAUNDRY	14
15	Receptacle MASTER BED	20 A	1		720 VA 1500...	1	20 A	Receptacle REFRIGERATOR	16
17	Receptacle PRIVATE LIVING	20 A	1		720 VA 1500...	1	20 A	Receptacle WET KITCHEN	18

19	Receptacle PRIVATE LIVING	20 A	1			720 VA	1500...	1	20 A	Receptacle WET KITCHEN	18
21	Receptacle KITCHEN	20 A	1	1500...	1500...			1	20 A	Receptacle BED-2 WATER HEATER	20
21	Receptacle PANTRY	20 A	1		1500...	1500...		1	20 A	Receptacle ELECTRICAL HEATER GUST BATH	22
23	Receptacle KITCHEN	20 A	1			1500...	1500...	1	20 A	Receptacle ELECTRICAL HEATER SHOWER	24
25	Receptacle KITCHEN	20 A	1	1680...							26
27	Receptacle MUDROOM	20 A	1		1680...						28
29	Receptacle WET KITCHEN	20 A	1			1680...					30
31											32
33											34
35											36
37											38
39											40
41											42
Total Load:				15800 VA	15980 VA	15740 VA					
Total Amps:				132 A	133 A	131 A					

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals	
Receptacle	47520 VA	60.52%	28760 VA		
				Total Conn. Load:	47520 VA
				Total Est. Demand:	28760 VA
				Total Conn.:	132 A
				Total Est. Demand:	80 A

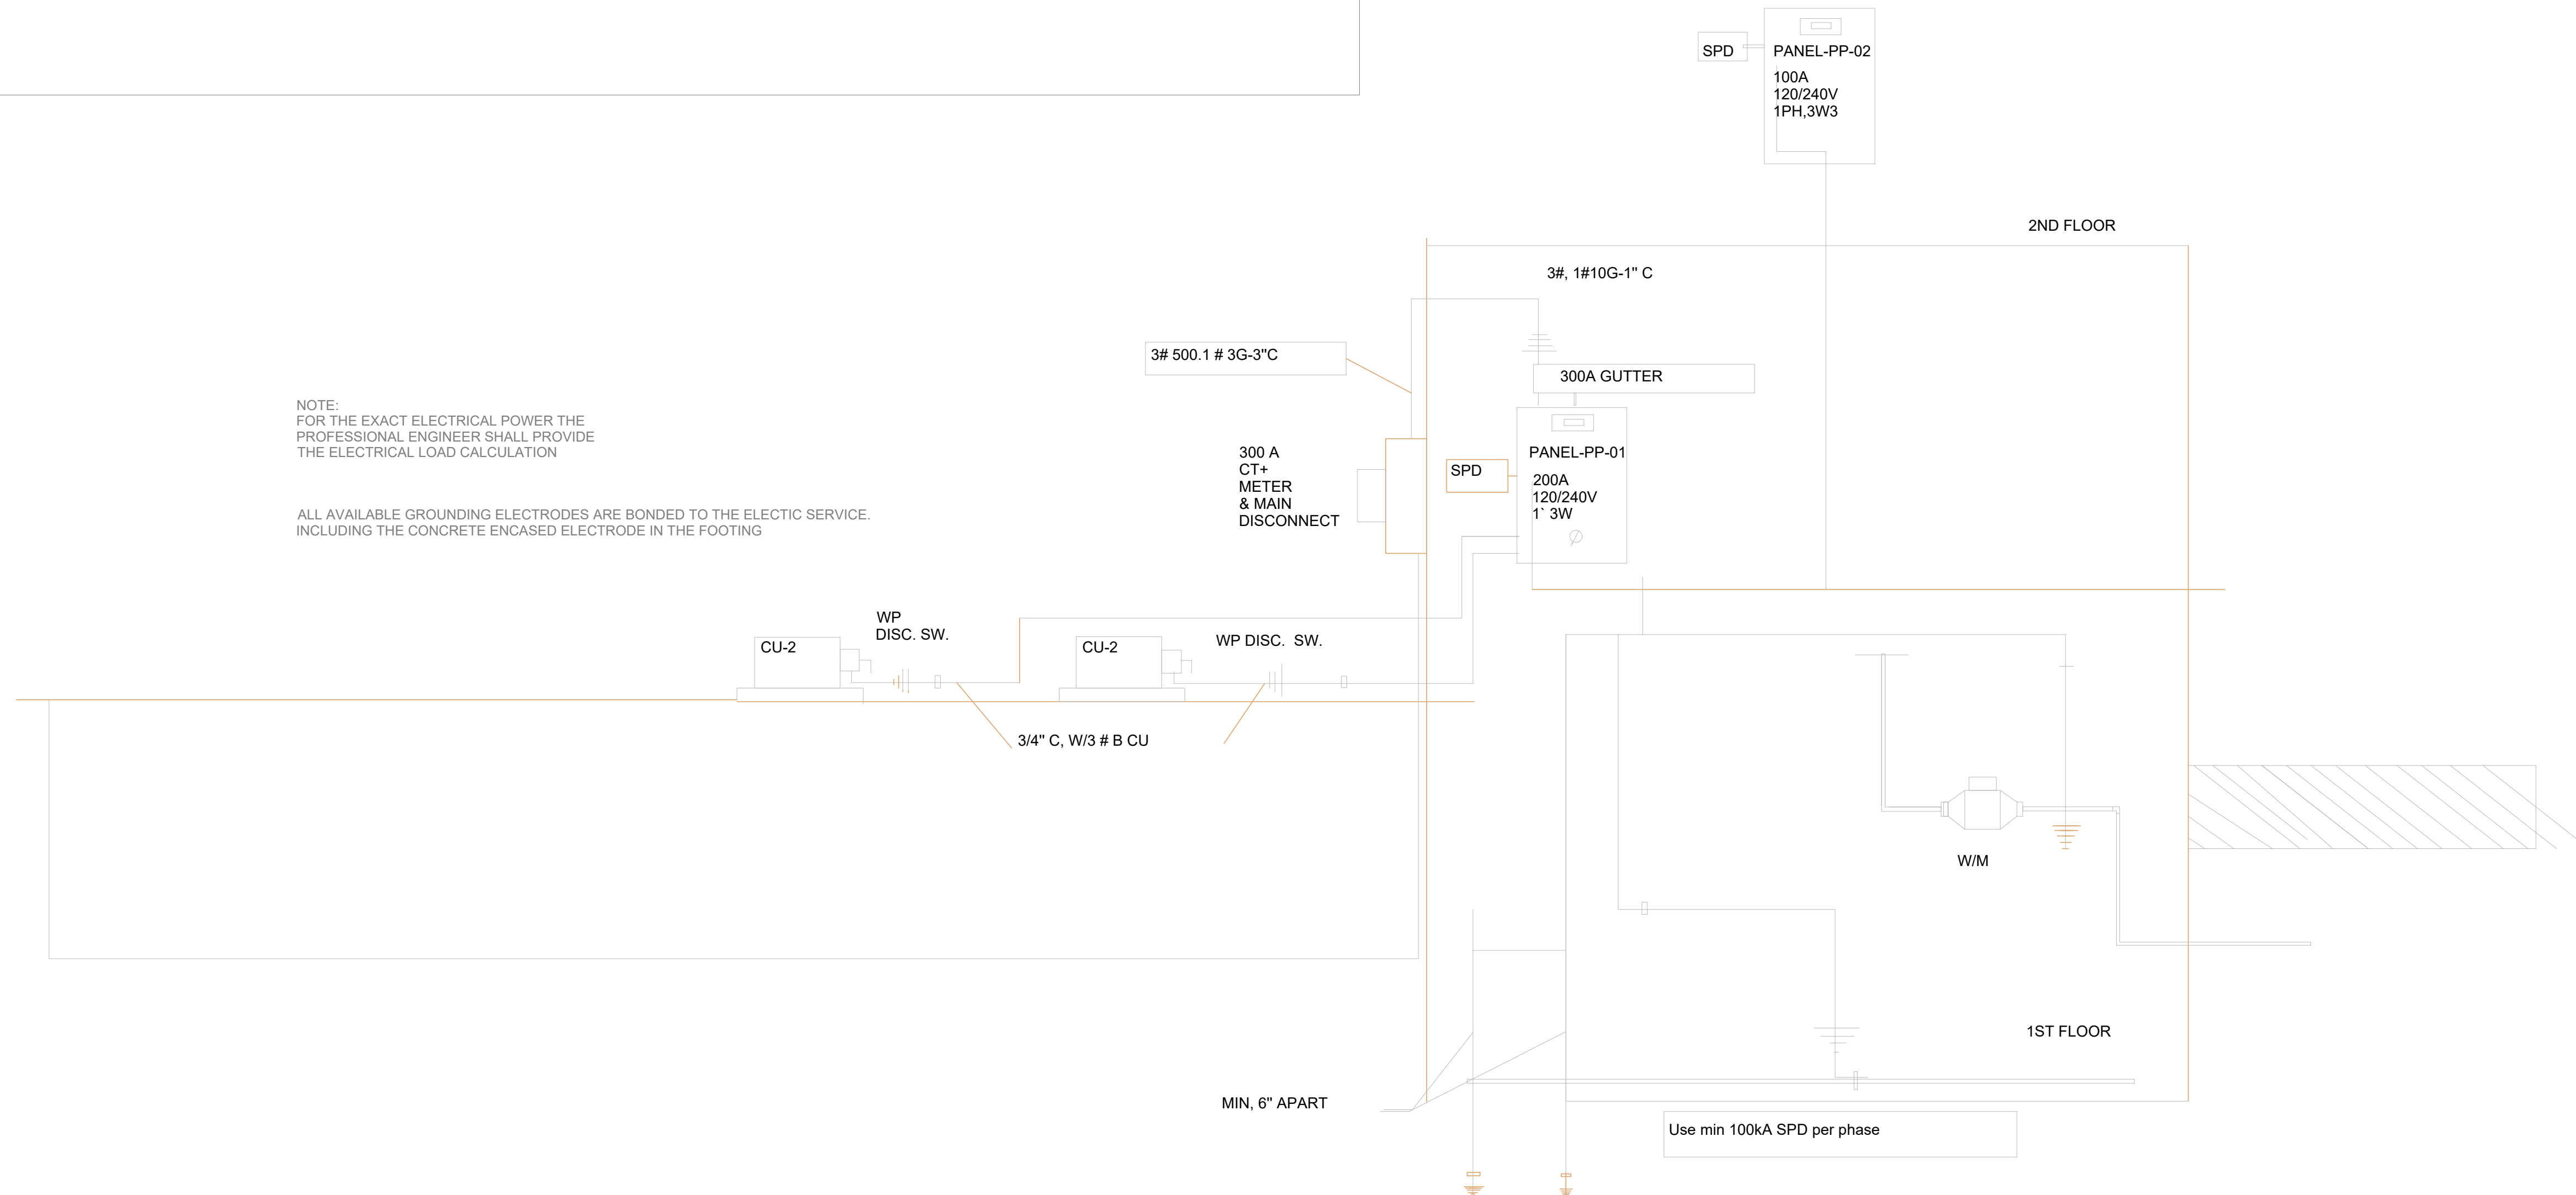

① 1 - Power
3/32" = 1'-0"

[illegible]

Owner

4659 BELCLAIRE AVENUE
HIHG LAND PARK,
TX 725209

FIRST AND SECOND
FLOOR LIGHT PANEL

Project Number	Project Number
Date	Issue Date
Drawn By	Author
Checked By	Checker

EE-02

Scale	$3/32" = 1'-0"$
-------	-----------------